

Halton Ivo ITR, pressure relief damper - Technical description

Contents

1	Introduction	3
1.1	Copyright and disclaimers	3
1.2	About this document	3
1.3	Summary of changes	3
2	Product description	3
2.1	Overview	4
2.2	Operating principle	5
2.3	Features and options	5
2.4	Structure and materials	6
2.5	Dimensions and weight	7
2.6	Specification	8
2.7	Order code	8
3	Design information	9
3.1	Standards	9
3.2	Installation	9
3.3	Servicing	10

1 Introduction

1.1 Copyright and disclaimers

This document remains the sole property of Halton and may not be duplicated, borrowed, copied, amended, modified, reproduced, transmitted or distributed to any third party without the prior written consent of Halton. Any information held in this document or associated materials may only be used for the purpose specified in this document.

Halton disclaims any and all liability related to this document. Halton gives no explicit or implied warranties in terms of this document. Any permitted use of the information included herein is at your own risk. Halton may amend or replace the information included in this document at its sole discretion without further notice and liability.

All intellectual property rights or applications thereof, including without limitation copyright, model rights, patents, trade secrets, trade names, trademarks, know-how (whether registered or unregistered) attributable to this document remain the sole and exclusive property of Halton. No rights or licenses are granted.

1.2 About this document

This technical description is intended for anyone needing detailed technical information about the product. It also provides general design-related information, such as design examples. More detailed designs can be carried out using the Halton eHIT selection tool, available at www.ehit.halton.com.

1.3 Summary of changes

Release	Date	Description
1.0	14-NOV-2024	First approved version

2 Product description

2.1 Overview



The Halton Ivo ITR pressure relief damper, a reliable evolution of the EI120S fire damper, is marked and tested according to its respective standards. It is fire-resistant and provides insulation with low smoke leakage. In normal mode, it is closed, and opens in an extinguishing situation to release excess pressure. This product can be installed horizontally or vertically in concrete, masonry, and lightweight structures, providing a reliable solution for your safety needs.

Application areas

- Buildings
- IT facilities
- Archives

Key features

- All units are factory tested to guarantee performance
- Operating pressure 6 bar (factory setting)
- Supply pressure max. 60 bar
- Closing pressure 300 Pa
- Actuator ATEX certified
- The structure is based on a CE-marked fire damper
- Sizes available from 200x200 mm up to 1000x800 mm
- Designed for use with gas extinguishing systems
- Suitable for use in demanding conditions

2.2 Operating principle

The pressure relief damper Halton Ivo ITR, based on the EI120 fire damper, is a reliable unit equipped with a pneumatic actuator and pressure reducer. Upon activation of the gas extinguishing system, the pneumatic actuator opens the damper, reducing the pressure level inside the room. Once the pressure is balanced, the spring inside the pneumatic actuator closes the damper, demonstrating its dependable functionality.

- The pressure relief damper is closed in normal mode and opens in an extinguishing situation to remove excess pressure from space.
- After the extinguishing situation, the pressure relief damper closes to the closed position with the help of a mechanical spring.
- Halton recommends performing a functional test of the gas extinguishing system before commissioning the premises.

This pressure relief damper is a vital part of the automatic gas extinguishing system to release excess gas from space and to avoid any damage to building construction due to high pressure. IT facilities and special facilities such as archives use gas extinguishing systems. These facilities can cause severe consequences by damaging data and assets. The interruption of operations or destruction of assets are potential outcomes. Hence, these automatic gas extinguishing systems, which extinguish gases such as argon, other inert gases, CO₂, and Novec, often protect such facilities.

2.3 Features and options

Feature	Description
Pneumatic actuator	Spring return and pressure reducer
Size	200x200 - 1000x800 mm
Weight	7 - 26 kg
Pressure difference in ducts	1200 Pa
Integrated installation frame	Galvanised steel (Stainless steel option available)

2.4 Structure and materials

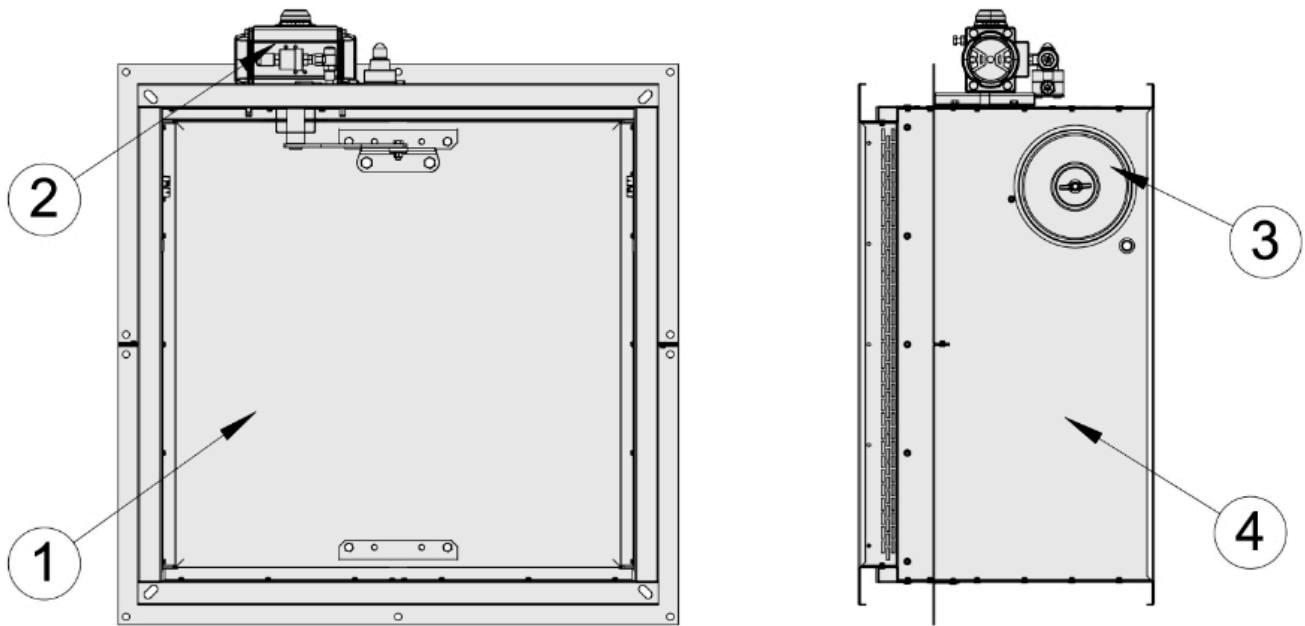


Fig. 1. Halton Ivo ITR structure

No.	Part	Material	Note
1	Blade	Asbestos free boards made of mineral fiber	-
2	Operating model (actuator)	-	Pneumatic, including pressure reducer.
3	Inspection hatch covering	Galvanised steel	Stainless steel, when casing also stainless
4	Casing	Galvanised steel	Stainless steel options available on request

2.5 Dimensions and weight

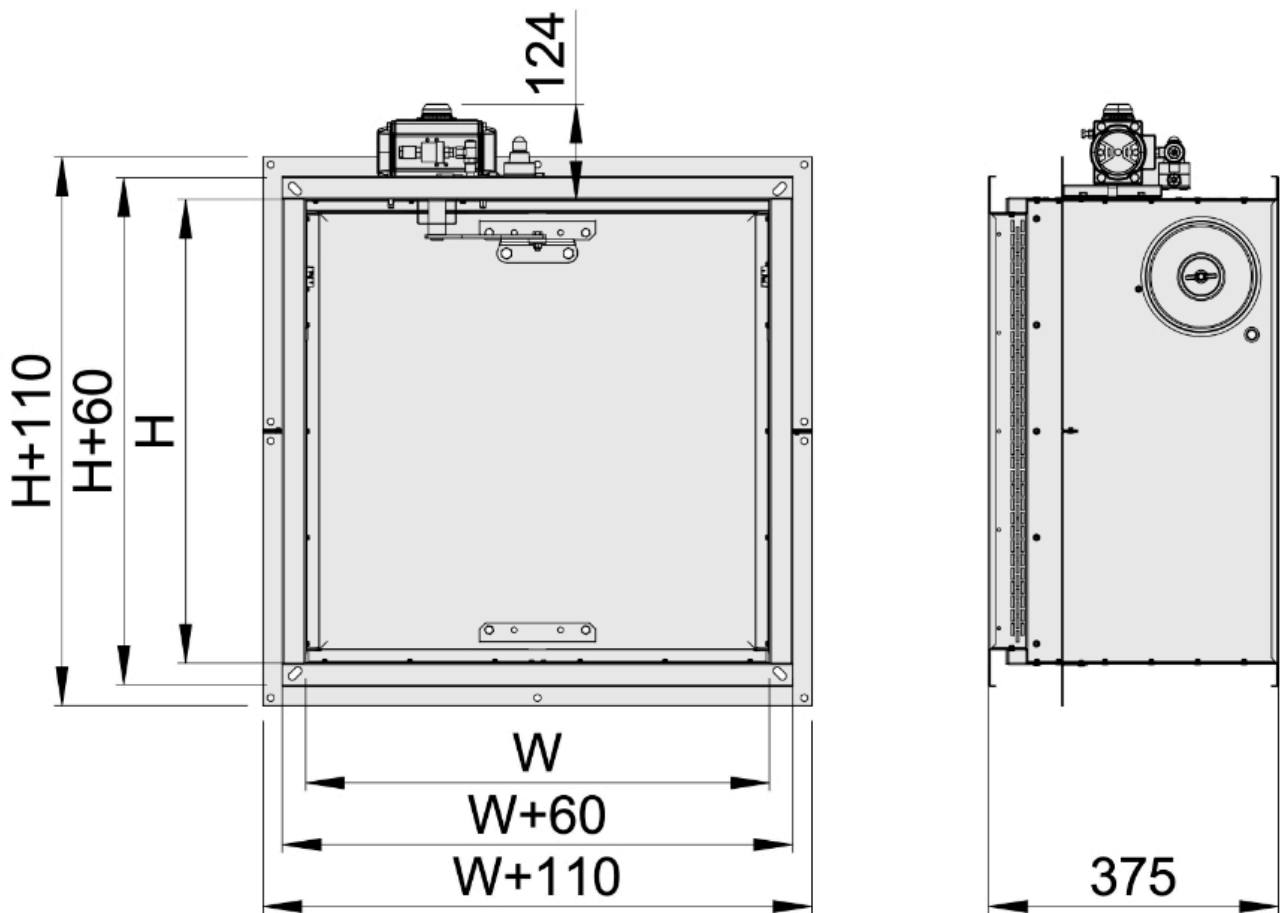


Fig. 2. Halton Ivo ITR dimensions

W [mm]	H [mm]
200, 250, 300, 350, 400, 450, 500, 550, 600, 700, 800, 900, 1000	200, 250, 300, 350, 400, 450, 500, 550, 600, 700, 800

Weight [kg]

H [mm]	W [mm]												
	200	250	300	350	400	450	500	550	600	700	800	900	1000
200	7.1	7.6	8.1	9.1	9.6	10.1	10.6	11.1	11.6	13.1	14.1	15.6	16.6
250	8.1	8.6	9.1	10.1	10.6	11.1	11.6	12.6	13.1	14.1	15.6	17.1	18.1
300	8.6	9.1	10.1	10.6	11.1	12.1	12.6	13.6	14.1	15.6	17.1	18.1	19.6
350	9.6	10.1	11.1	12.1	12.6	13.6	14.1	15.1	15.6	17.1	18.6	20.1	21.6
400	10.1	11.1	11.6	12.6	13.6	14.1	15.1	15.6	16.6	18.1	20.1	20.6	23.1
450	10.6	11.6	12.6	13.6	14.1	15.1	16.1	16.6	17.6	19.6	21.1	23.1	24.6

H [mm]	W [mm]												
	200	250	300	350	400	450	500	550	600	700	800	900	1000
500	11.1	12.1	13.1	14.1	15.1	16.1	17.1	17.6	18.6	21.1	22.6	24.1	26.1
550	12.1	13.1	14.1	15.1	16.1	17.1	17.6	18.6	19.6	22.6	23.6	25.6	-
600	12.6	13.6	14.6	15.6	16.6	17.6	18.6	19.6	21.1	24.1	25.1	-	-
700	13.6	15.1	16.1	17.6	18.6	19.6	20.6	22.1	23.1	-	-	-	-
800	15.1	16.1	17.6	19.1	20.1	21.1	22.6	23.6	25.1	-	-	-	-

(-) = size not available

2.6 Specification

The pressure relief damper Halton Ivo ITR, based on the EI120 fire damper, is a reliable unit equipped with a pneumatic actuator and pressure reducer. Its structure is based on a CE-approved fire damper and ATEX-approved actuator. It is tested according to CE certification standards EN15650 and EN 1366-2 for fire testing as a fire damper.

Construction

- The in-wall installation allows for the installation of the spindle of the blade at any position (360°).
- In concrete, masonry and lightweight structures, you can install fire dampers in both vertical and horizontal positions.
- Leakage through closed damper blade fulfils EN 1751 class 2
- The casing complies with the tightness requirements for EN 1751 class C. According to EN 1751, leakage through a closed damper blade fulfils class 2.
- It can be installed away from the separate element up to 1.0 metre, fulfilling fire resistance classes up to EI 90 ($v_e h_o i \leftrightarrow o$) S.
- A maximum fire resistance class EI 120 ($v_e h_o i \leftrightarrow o$) S requirements.

Material

- The casing complies with the tightness requirements for EN 1751 class C. According to EN 1751, leakage through a closed damper blade fulfils class 2.
- Galvanised or stainless steel (AISI 316L) casing, with the blade made of fire-resistant and asbestos-free boards (mineral fibre).
- Equipped with one inspection hatch, which allows you to check the position of the damper blade.

2.7 Order code

ITR-W-H; MA-AC-ZT

Main options	
W = Duct connection width [mm]	200, 250, 300, 350, 400, 450, 500, 550, 600, 700, 800, 900, 1000
H = Duct connection height [mm]	200, 250, 300, 350, 400, 450, 500, 550, 600, 700, 800

Other options and accessories	
MA = Material	
GS	Galvanised steel
AC = Accessories	
NA	Not assigned
N2	Safetymesh in both ends
ZT = Tailored product	
N	No
Y	Yes (ETO)

Order code example
ITR-600-400; MA=GS, AC=N2, ZT=N

3 Design information

3.1 Standards

There is no harmonized product standard for pressure relief dampers.

The structure of this damper is based on for CE-approved fire damper and ATEX-approved actuator, with the exception that this is opened with inert gas release (extinguishing gas displaces oxygen) in connection with overpressure to lead away.

Complies with ventilation of building standard EN 15650 (CE)

The basis of this product complies with the following standards:

Performance/processes	Standard
Fire classification (EI 120 (v _e h ₀ i↔o) S, EI 90 (v _e h ₀ i↔o) S, EI 60 (v _e h ₀ i↔o) S)	EN 13501-3+A1 standard
Fire testing	EN 1366-2
Construction Products Regulation (CPR)	1391-CPR-2018/0202
Declaration of Performance (DoP)	10034-ESR-2019/01/01
Leakage through closed damper blade fulfils class 2	EN 1751
Damper casing tightness class C	EN 1751
Corrosion resistance (Salt mist test)	EN 60068-2-52

3.2 Installation

Suitable for both vertical (wall) and horizontal (ceiling/floor) mounting. The damper's blade spindle can be

positioned at any angle (360°) during wall installation, allowing for greater flexibility. Capable of being installed up to 1.0 meters away from the main structure while maintaining a fire resistance of EI 90 S.

Fire resistance classification:

- Certified for use in concrete, masonry, or lightweight structures.
- Complies with fire resistance classes EI 120, EI 90, or EI 60.
- Fully CE marked for adherence to safety and quality standard.

To ensure optimal performance, a minimum amount of free space must be left around the damper's body during installation.

Note: More detailed information can be found in the Installation Guide for this fire damper. You can download it from the "Downloads" section, when available.

3.3 Servicing

No regular maintenance is required for the product.

Inspection must be carried out regularly according to local building codes, to ensure proper operation of fire dampers. **The minimum recommended inspection period is every 6 months.** Save the documentation of testing needs for future needs.

The pressure relief damper is equipped with one inspection hatch, enabling the possibility to check the position of the damper blade. The actuator includes position indicators, open and close.

Upon failure during testing of the pressure relief damper, maintenance service shall order from an authorised Halton representative to ensure appropriate operation of the product.