


Smoke control damper

Installation guide for Halton Sec SFC

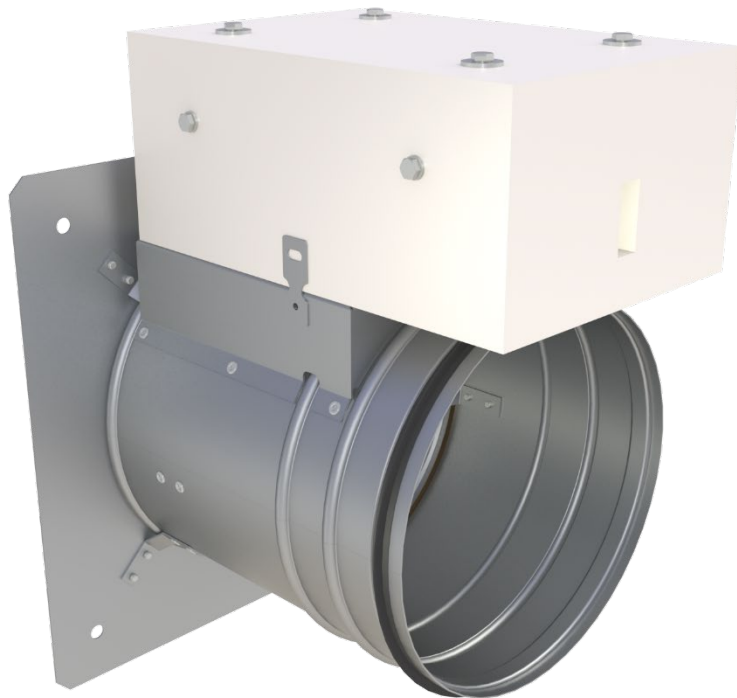

Fire resistance class **E₆₀₀ 120 (v_{ed-i↔o}) S 1500C₁₀₀₀₀ MA_{single}**
CE certificate of Constancy of Performance No: 1391-CPR-2018/0210
Declaration of Performance No: 10035-SFC-2019/01/01
CE certified according to product standard EN 12101-8

Contents

| | |
|--|----|
| 1 Introduction | 3 |
| 1.1 About this document | 3 |
| 1.2 Document copyright and disclaimer..... | 3 |
| 2 Dimensions | 4 |
| 2.1 Damper dimensions (mm)..... | 4 |
| 2.1 Minimum distances..... | 4 |
| 3 Installation..... | 5 |
| 3.1 Main points before you start..... | 5 |
| 3.2 Mounting the smoke control damper | 6 |
| 3.2.1 Smoke control duct | 6 |
| 3.3 More details | 10 |
| 3.3.1 Connection holes details for wires | 10 |
| 4 Key technical data..... | 11 |
| 4.1 Wiring | 11 |
| 4.1.1 Belimo, AC/DC 24 V, open-close | 11 |
| 4.1.2 Belimo, AC 230 V, open-close..... | 12 |
| 4.2 Actuators | 13 |

1 Introduction

1.1 About this document

This guide provides guidelines for installing the Smoke control damper.

1.2 Document copyright and disclaimer

The contents of this document are for information purposes only. This document remains the sole property of Halton and may not be duplicated, borrowed, copied, amended, modified or reproduced. Any information held in this document or associated materials may only be used for the purpose specified in this document.

Halton disclaims any and all liability related to this document. Halton gives no explicit or implied warranties in terms of this document. Any permitted use of the information included herein is at your own risk. Halton may amend or replace the information included in this document at its sole discretion without further notice and liability.

All intellectual property rights or applications thereof, including without limitation copyright, model rights, patents, trade secrets, trade names, trademarks, know-how (whether registered or unregistered) attributable to this document remain the sole and exclusive property of Halton. No rights or licenses are granted.

2 Dimensions

2.1 Damper dimensions (mm)

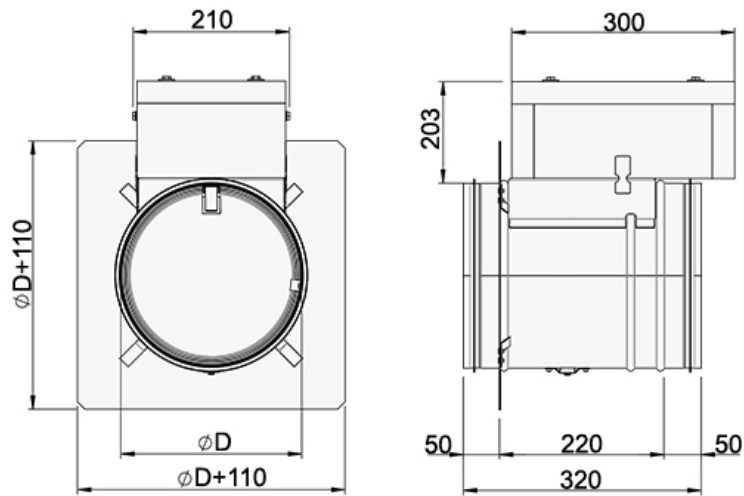


Fig. 1.

2.1 Minimum distances

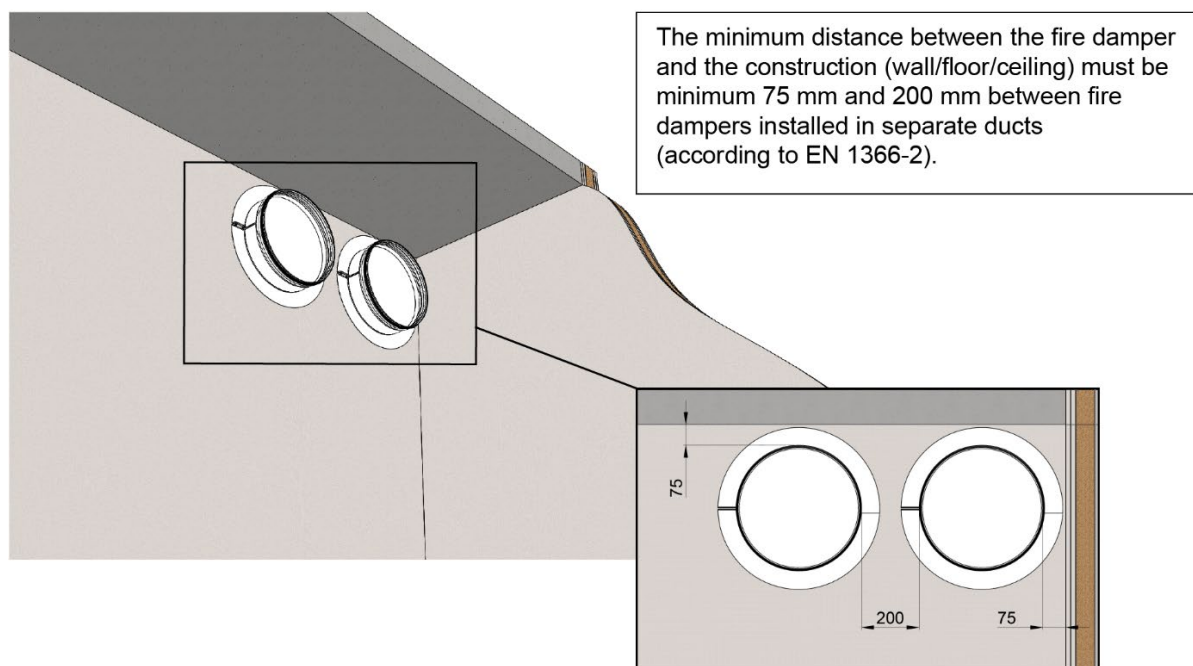


Fig. 2. The distance between the smoke control damper and construction

3 Installation

3.1 Main points before you start

1. Halton manufactures and supplies only the smoke control damper element of any installation method. All other components or materials mentioned in this guide must be supplied and fitted by the appropriate contractor as accepted best practice, regulation or guidelines for the country in which they are being installed.
2. Perform visual inspection of the condition of the damper before installation.
3. Smoke extraction dampers single are designed for installation with horizontal blade axis.
4. The blade must be in close position during installation.
5. The control mechanism must be protected against damage and pollution during installation process with e.g. plastic cover.
6. For installation of Halton smoke control dampers, hangers or supports should be fitted to ensure that there is no load on the smoke control damper itself and should be installed as accepted best practice, regulation or guidelines for the country in which they are being installed (e.g. for the UK this is DW144).
7. Functionality of the damper must be tested before and after installation and after filling the gap between damper and construction.
8. Fill the gap between damper and construction with mortar or gypsum, e.g. HILTI, SIKLA, MÜPRO etc.

Note: The minimum recommended inspection period is every 6 months or according to the building code.

3.2 Mounting the smoke control damper

3.2.1 Smoke control duct

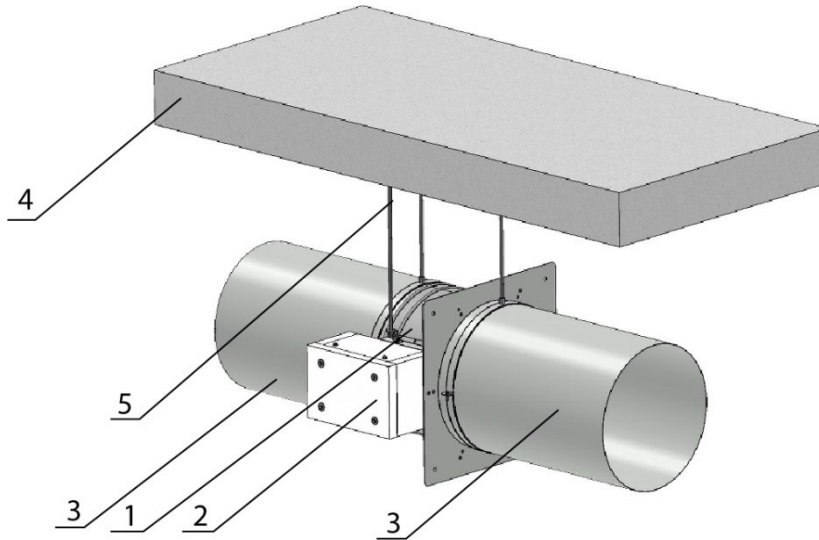


Fig. 3. Installation to horizontal duct.

Key:

1. Halton smoke control damper
2. Cover of actuating mechanism, removable after installation (actuator inside the cover)
3. Smoke control duct
4. Solid floor construction
5. Treaded rod

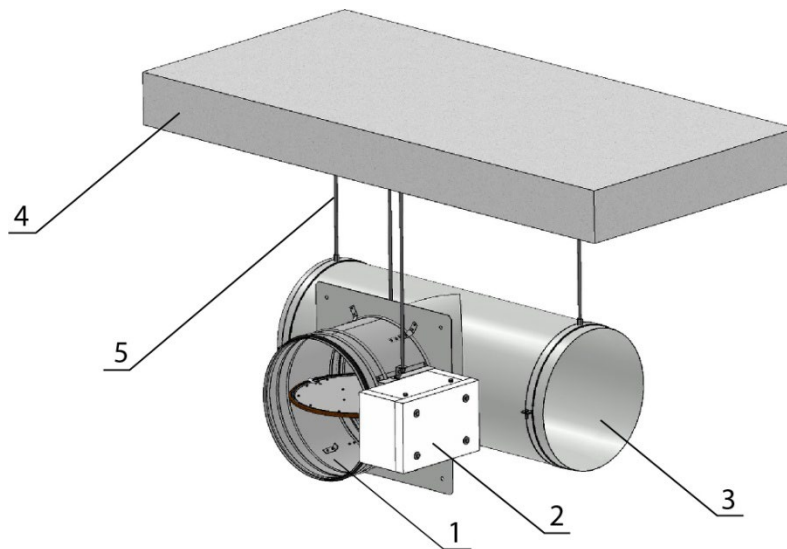


Fig. 4. Installation to the side of horizontal duct.

Key:

1. Halton smoke control damper
2. Cover of actuating mechanism, removable after installation (actuator inside the cover)
3. Smoke control duct
4. Solid floor construction
5. Treaded rod

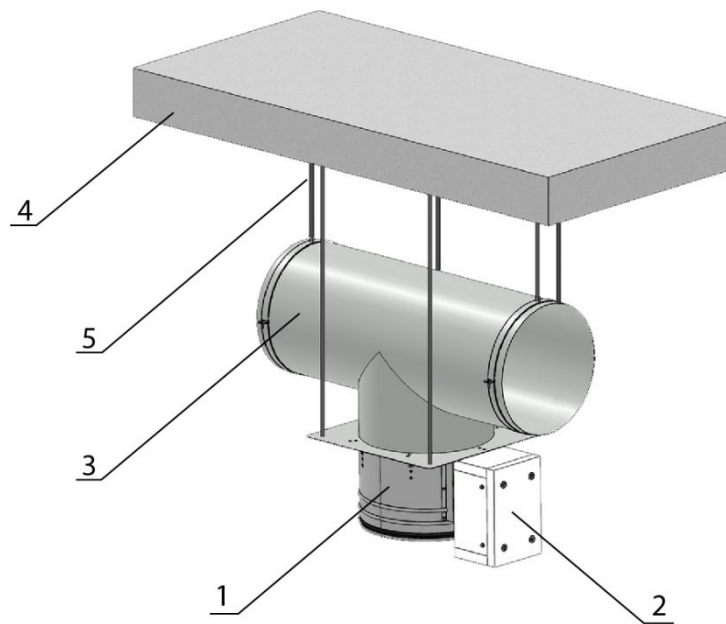


Fig. 5. Installation below the horizontal duct.

Key:

1. Halton smoke control damper
2. Cover of actuating mechanism, removable after installation (actuator inside the cover)
3. Smoke control duct
4. Solid floor construction
5. Treaded rod

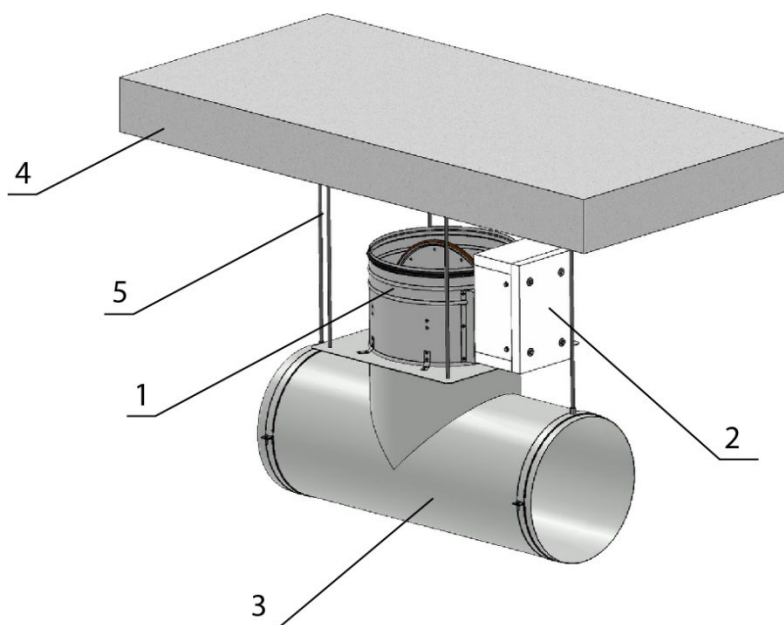


Fig. 6. Installation above the horizontal duct.

Key:

1. Halton smoke control damper
2. Cover of actuating mechanism, removable after installation (actuator inside the cover)
3. Smoke control duct
4. Solid floor construction
5. Treaded rod

3.3 More details

3.3.1 Connection holes details for wires

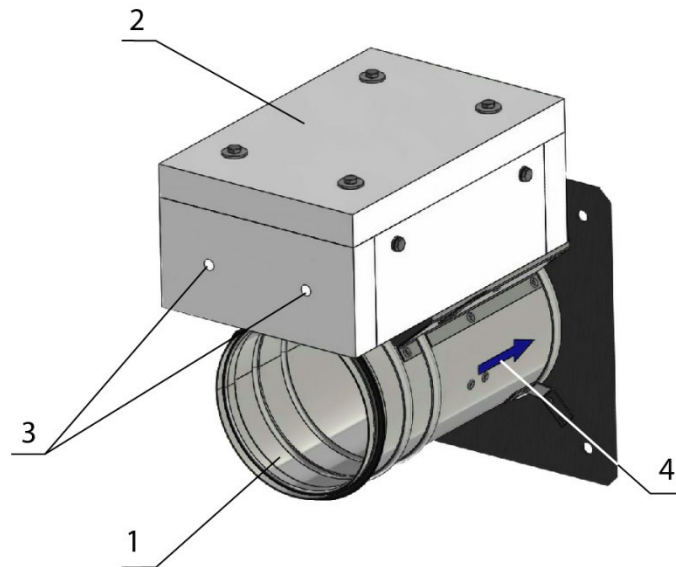


Fig. 7.

Key:


1. Halton smoke control damper
2. Cover of actuating mechanism, removable after installation (actuator inside the cover)
3. Drill two connection holes Ø10mm for heat resistant cable
4. Airflow direction

4 Key technical data


4.1 Wiring

4.1.1 Belimo, AC/DC 24 V, open-close

AC/DC 24 V, open/close

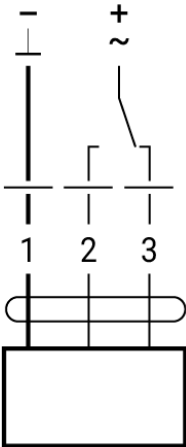

Auxiliary switch

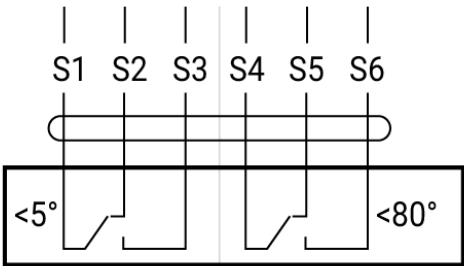


Wire colours:

- 1 = black
- 2 = red
- 3 = white
- S1 = violet
- S2 = red
- S3 = white
- S4 = orange
- S5 = pink
- S6 = grey


| Electrical installation | | |
|-------------------------|-------|---|
| | Notes | <ul style="list-style-type: none">• Connection via safety isolating transformer• Parallel connection of other actuators possible. Observe the performance data.• Combination of power supply voltage and safety extra-low voltage not permitted at the both auxiliary switches. |
| | | |

4.1.2 Belimo, AC 230 V, open-close

AC 230 V, open/close

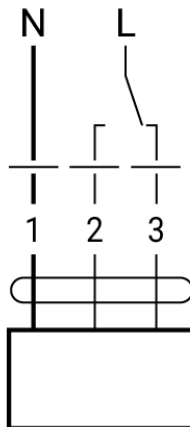

Auxiliary switch

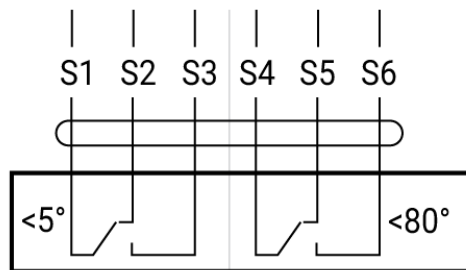

Wire colours:

- 1 = blue
- 2 = brown
- 3 = white
- S1 = violet
- S2 = red
- S3 = white
- S4 = orange
- S5 = pink
- S6 = grey

Electrical installation



Notes

- Caution: Power supply voltage!
- The actuator must be protected by a fuse that does not exceed 16 A.
- Parallel connection of other actuators possible. Observe the performance data.
- Combination of power supply voltage and safety extra-low voltage not permitted at the both auxiliary switches.

4.2 Actuators

| Actuating mechanism, Belimo | BEN 230 | BEN 24 |
|--|--|---|
| Nominal voltage | AC 230 V 50/60 Hz | AC/DC 24 V 50/60 Hz |
| Power consumption - in operation - at rest | 4 W 0,4 W | 3 W 0,1 W |
| Power consumption for wire sizing note | 7 VA (I _{max} 3 A @ 5 ms) | 6 VA (I _{max} 8,2 A @ 5 ms) |
| Protection class | II | III |
| Degree of protection IEC/EN | IP 54 | |
| Running time for 90° | < 30 s | |
| Ambient temperature range Non-operating temperature | - 30 °C...55 °C - 40 °C...80 °C | |
| Connecting - in operation - auxiliary switch | Cable 1 m, 3 x 0,75 mm ² (halogen-free) Cable 1 m, 6 x 0,75 mm ² (halogen-free) | |

| Actuating mechanism, Belimo | BE 230-12 | BE 24-12 (-ST) |
|--|--|--|
| Nominal voltage | AC 230 V 50/60 Hz | AC 24 V 50/60 Hz DC 24 V |
| Power consumption - in operation - at rest | 8 W 0,5 W | 12 W 2 W |
| Power consumption for wire sizing note | 15 VA (I _{max} 7,9 A @ 5 ms) | 18 VA (I _{max} 8,2 A @ 5 ms) |
| Protection class | II | III |
| Degree of protection IEC/EN | IP 54 | |
| Running time for 95° | < 60 s | |
| Ambient temperature range Non-operating temperature | - 30 °C...50 °C - 40 °C...80 °C | |
| Connecting - in operation - auxiliary switch | Cable 1 m, 2 x 0,75 mm ² (halogen-free) Cable 1 m, 6 x 0,75 mm ² (halogen-free) (BE 24-ST) with plug-in connectors | |